


July 2026 ASHRAE Journal Online Content

Below is supplementary information for this article in the July 2026 issue of *ASHRAE Journal*:

Enhancing HVAC Efficiency Through Integrated Chilled and Hot Water Loops

By Nabil Nassif, PH.D., P.E., Member ASHRAE

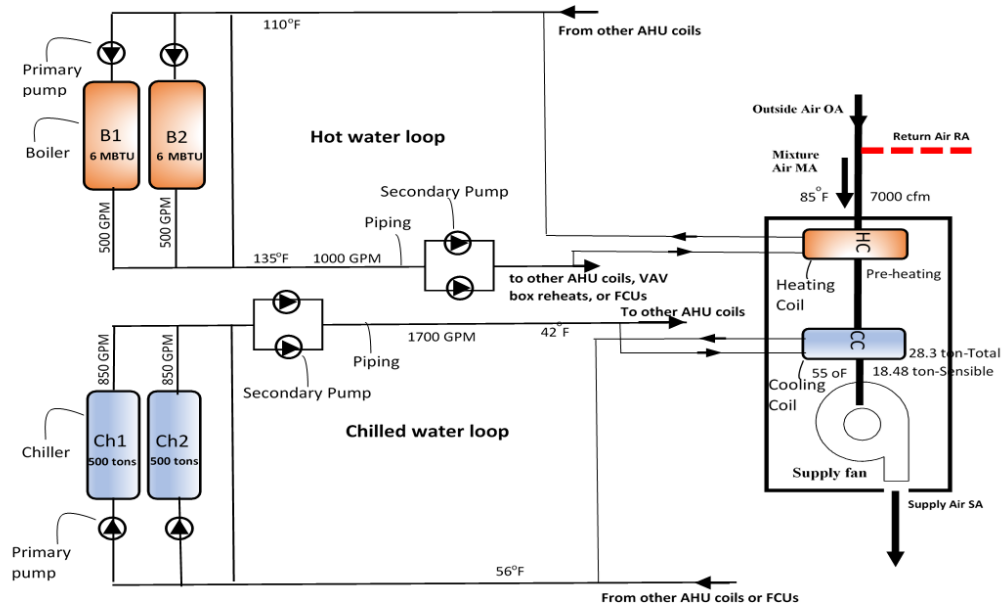

Online Figure 1: Traditional chilled water VAV system. The heating coil is placed upstream of the cooling coil.