


**Errata to ASHRAE Pocket Guide for Air Conditioning, Heating, Ventilation, Refrigeration
(SI Edition)**

January 16, 2008

Page Errata

I-3 The graphs on these pages should be replaced with the single following graph, as data are missing for flow rates between 500 and 1000 L/s.

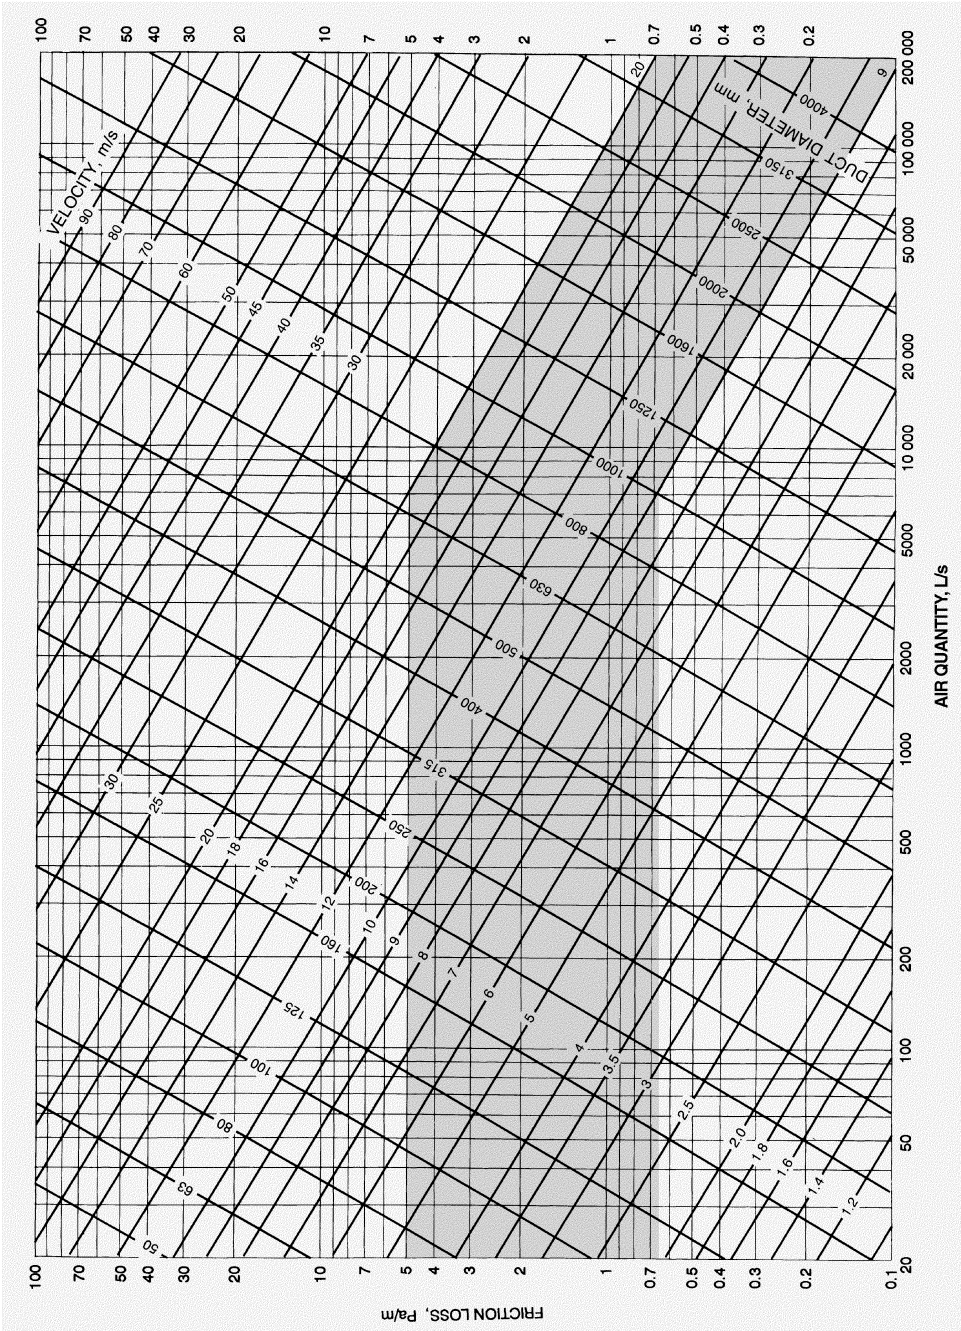

Page**Errata****12**

In the equation at the top of the page, the number 40350 should be replaced by 1005.

47

In the equation at the top of the page, the number in the denominator should be 101, **not** 161.