



ADDENDA

**ASHRAE Addendum z to
ASHRAE Guideline 36-2018**

High Performance Sequences of Operation for HVAC Systems

Approved by ASHRAE on July 9, 2021.

This addendum was approved by a Standing Guideline Project Committee (SGPC) for which the Standards Committee has established a documented program for regular publication of addenda or revisions, including procedures for timely, documented, consensus action on requests for change to any part of the guideline. Instructions for how to submit a change can be found on the ASHRAE® website (<https://www.ashrae.org/continuous-maintenance>).

The latest edition of an ASHRAE Standard may be purchased from the ASHRAE website (www.ashrae.org) or from ASHRAE Customer Service, 180 Technology Parkway NW, Peachtree Corners, GA 30092. E-mail: orders@ashrae.org. Fax: 678-539-2129. Telephone: 404-636-8400 (worldwide), or toll free 1-800-527-4723 (for orders in US and Canada). For reprint permission, go to www.ashrae.org/permissions.

ASHRAE Standing Guideline Project Committee 36

Cognizant TC: 1.4, Control Theory and Application

SPLS Liaison: Christian Taber

Steven T. Taylor*, *Chair*
Gwenlen Paliaga*, *Vice-Chair*
James C. Bradburn*, *Secretary*
Christopher R. Amundson*
Jeffrey G. Boldt*
Barry Bridges
Ronald Bristol*
Lance R. Brown
Anthony Bruno
Cynthia A. Callaway*
Gregory Cmar*
Yan Chen
C. Hwakong Cheng
James J. Coogan*
Carl A. Crow
Clark R. Denson

Brent R. Eubanks*
Richard A. Farmer
Michael Galler*
Christopher Sean Gosline
Siddharth Goyal
Milica Grahovac
Nathan Hampton*
David B. Kahn
Srinivas Katipamula*
Adam T. Keeling
Reece Kiriu
Eric Koepfel*
Kevin Li*
Ed G. Morris
David Morrow
Kevin Ng

Aaron Opatz*
Jeremy J. Ouellette*
Chirag D. Parikh
James Parker
Michael A. Pouchak*
David John Pritchard
Paul Raftery*
Brian W. Russell
Robert K. Sibley
Steven C. Sill
Jonathan R. Smith
Henry Frederick Stehmeyer IV
Levi Tully*
Chariti A. Young*
Bei Zhang
Xiaohui Zhou*

* Denotes members of voting status when the document was approved for publication

ASHRAE STANDARDS COMMITTEE 2021–2022

Rick M. Heiden, *Chair*
Susanna S. Hanson, *Vice-Chair*
Charles S. Barnaby
Robert B. Burkhead
Thomas E. Cappellin
Douglas D. Fick
Michael W. Gallagher
Patricia Graef
Srinivas Katipamula
Gerald J. Kettler

Essam E. Khalil
Malcolm D. Knight
Jay A. Kohler
Cesar L. Lim
Paul A. Lindahl, Jr.
James D. Lutz
Julie Majurin
Lawrence C. Markel
Margret M. Mathison
Gwelen Paliaga

Justin M. Prosser
David Robin
Lawrence J. Schoen
Steven C. Sill
Christian R. Taber
Russell C. Tharp
William F. Walter
Craig P. Wray
Jaap Hogeling, BOD ExO
Tim J. McGinn, CO

Connor Barbaree, *Senior Manager of Standards*

SPECIAL NOTE

This Guideline was developed under the auspices of ASHRAE. ASHRAE Guidelines are developed under a review process, identifying a Guideline for the design, testing, application, or evaluation of a specific product, concept, or practice. As a Guideline it is not definitive but encompasses areas where there may be a variety of approaches, none of which must be precisely correct. ASHRAE Guidelines are written to assist professionals in the area of concern and expertise of ASHRAE's Technical Committees and Task Groups.

ASHRAE Guidelines are prepared by Project Committees appointed specifically for the purpose of writing Guidelines. The Project Committee Chair and Vice-Chair must be members of ASHRAE; while other committee members may or may not be ASHRAE members, all must be technically qualified in the subject area of the Guideline.

Development of ASHRAE Guidelines follows procedures similar to those for ASHRAE Standards except that (a) committee balance is desired but not required, (b) an effort is made to achieve consensus but consensus is not required, (c) Guidelines are not appealable, and (d) Guidelines are not submitted to ANSI for approval.

The Senior Manager of Standards of ASHRAE should be contacted for

- a. interpretation of the contents of this Guideline,
- b. participation in the next review of the Guideline,
- c. offering constructive criticism for improving the Guideline, or
- d. permission to reprint portions of the Guideline.

DISCLAIMER

ASHRAE uses its best efforts to promulgate Standards and Guidelines for the benefit of the public in light of available information and accepted industry practices. However, ASHRAE does not guarantee, certify, or assure the safety or performance of any products, components, or systems tested, installed, or operated in accordance with ASHRAE's Standards or Guidelines or that any tests conducted under its Standards or Guidelines will be nonhazardous or free from risk.

ASHRAE INDUSTRIAL ADVERTISING POLICY ON STANDARDS

ASHRAE Standards and Guidelines are established to assist industry and the public by offering a uniform method of testing for rating purposes, by suggesting safe practices in designing and installing equipment, by providing proper definitions of this equipment, and by providing other information that may serve to guide the industry. The creation of ASHRAE Standards and Guidelines is determined by the need for them, and conformance to them is completely voluntary.

In referring to this Standard or Guideline and in marking of equipment and in advertising, no claim shall be made, either stated or implied, that the product has been approved by ASHRAE.

(This foreword is not part of this guideline. It is merely informative and does not contain requirements necessary for conformance to the guideline. It has not been processed according to the ANSI requirements for a guideline and may contain material that has not been subject to public review or a consensus process. Unresolved objectors on informative material are not offered the right to appeal at ASHRAE or ANSI.)

FOREWORD

This addendum is to allow cooling-only terminal units to provide heating in occupied, warm-up, and setback modes if the air handling unit supply air temperature is greater than room temperature.

Note: In this addendum, changes to the current guideline are indicated in the text by underlining (for additions) and strikethrough (for deletions) unless the instructions specifically mention some other means of indicating the changes.

Addendum z to Guideline 36-2018

(IP and SI Units)

Revise Paragraph 3.1.2.1 as follows:

3.1.2.1 VAV Cooling-Only Terminal Unit

- a. Zone maximum cooling airflow set point ($V_{cool-max}$)
- b. Zone maximum heating airflow setpoint ($V_{heat-max}$)

Cooling-only terminal units can provide when the AHU supply air temperature is more than 3°C (5°F) above the room temperature. The zone maximum heating airflow setpoint should be set to no more than the zone maximum cooling airflow setpoint.

- c. Zone minimum airflow set point (V_{min}). This is an optional entry. If no value is scheduled, or a value of “AUTO” is scheduled, V_{min} will be calculated automatically and dynamically to meet ventilation requirements.

In most cases, V_{min} should be allowed to be automatically calculated. This ensures compliance with Standard 62.1 and Standard 90.1 prescriptive requirements and with California's Title 24 Energy Standards requirements, and it results in the lowest energy costs.

Revise Paragraph 5.5.3 as follows:

- 5.5.3 See Section 3.1.2.1 for zone minimum airflow set point V_{min} , ~~and zone cooling-maximum cooling design~~ airflow set point $V_{cool-max}$ and zone maximum heating airflow setpoint $V_{heat-max}$.

If the minimum ventilation rate is more than 25% or so of the cooling maximum, or DCV is used, a reheat box is recommended to avoid overcooling. DCV logic is not provided for

cooling-only boxes, because doing so results in periods of overcooling, as the CO₂ levels due to occupants rises much faster than the cooling load due to occupants because of thermal mass.

Cooling-only terminal units can provide heating only when the AHU supply air temperature is more than 3°C (5°F) above the room temperature.

Revise Paragraph 5.5.4 as follows:

5.5.4 Active endpoints used in the control logic depicted in Figure 5.5.5 shall vary depending on the mode of the zone group the zone is a part of (see Table 5.5.4).

Table 5.5.4 Endpoints as a Function of Zone Group Mode

Endpoint	Occupied	Cooldown	Setup	Warm-Up	Setback	Unoccupied
Cooling maximum	Vcool-max	Vcool-max	Vcool-max	0	0	0
Minimum	Vmin*	0	0	0	0	0
Heating maximum	$\frac{Vmin*Vheat}{-max}$	0	0	$\theta Vcool-max$	$\theta Vcool-max$	0

Revise Paragraph 5.5.5 as follows:

5.5.5 Control logic is depicted schematically in Figure 5.5.5 and described in the following subsections.

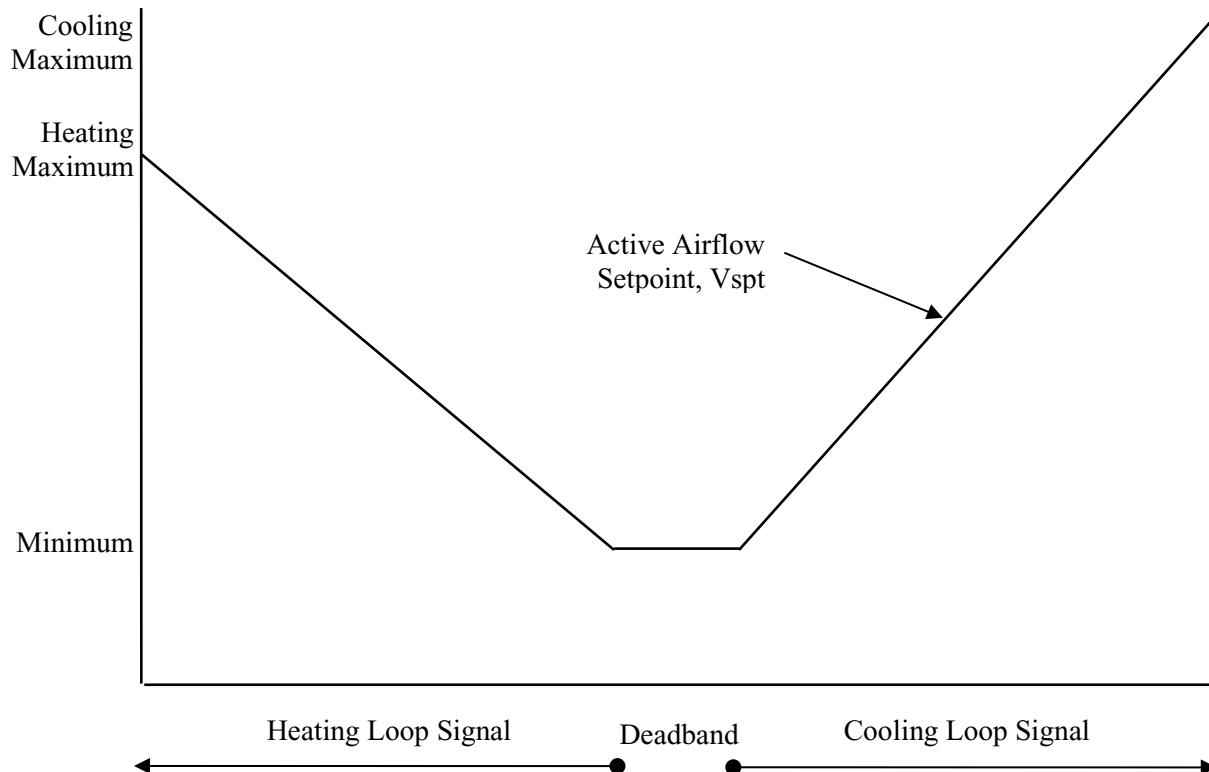


Figure 5.5.5 Control logic for cooling-only VAV zone.

- 5.5.5.1 When the zone state is cooling, the cooling-loop output shall be mapped to the active airflow set point from the minimum endpoint to the cooling maximum endpoint.
- d. If supply air temperature from the air handler is greater than room temperature, the active airflow set point shall be no higher than the minimum endpoint.
- 5.5.5.2 When the zone state is deadband, the active airflow set point shall be the minimum endpoint.
- 5.5.5.3 When the zone state is heating, the heating loop output shall be mapped to the active airflow setpoint from active airflow set point shall be the minimum endpoint to the heating maximum endpoint.
- a. If supply air temperature from the air handler is less than 3°C (5°F) above the room temperature, the active airflow setpoint shall be no higher than the minimum endpoint.
- 5.5.5.4 The VAV damper shall be modulated by a control loop to maintain the measured airflow at the active set point.

POLICY STATEMENT DEFINING ASHRAE'S CONCERN FOR THE ENVIRONMENTAL IMPACT OF ITS ACTIVITIES

ASHRAE is concerned with the impact of its members' activities on both the indoor and outdoor environment. ASHRAE's members will strive to minimize any possible deleterious effect on the indoor and outdoor environment of the systems and components in their responsibility while maximizing the beneficial effects these systems provide, consistent with accepted Standards and the practical state of the art.

ASHRAE's short-range goal is to ensure that the systems and components within its scope do not impact the indoor and outdoor environment to a greater extent than specified by the Standards and Guidelines as established by itself and other responsible bodies.

As an ongoing goal, ASHRAE will, through its Standards Committee and extensive Technical Committee structure, continue to generate up-to-date Standards and Guidelines where appropriate and adopt, recommend, and promote those new and revised Standards developed by other responsible organizations.

Through its *Handbook*, appropriate chapters will contain up-to-date Standards and design considerations as the material is systematically revised.

ASHRAE will take the lead with respect to dissemination of environmental information of its primary interest and will seek out and disseminate information from other responsible organizations that is pertinent, as guides to updating Standards and Guidelines.

The effects of the design and selection of equipment and systems will be considered within the scope of the system's intended use and expected misuse. The disposal of hazardous materials, if any, will also be considered.

ASHRAE's primary concern for environmental impact will be at the site where equipment within ASHRAE's scope operates. However, energy source selection and the possible environmental impact due to the energy source and energy transportation will be considered where possible. Recommendations concerning energy source selection should be made by its members.

ASHRAE · 180 Technology Parkway NW · Peachtree Corners, GA 30092 · www.ashrae.org

About ASHRAE

Founded in 1894, ASHRAE is a global professional society committed to serve humanity by advancing the arts and sciences of heating, ventilation, air conditioning, refrigeration, and their allied fields.

As an industry leader in research, standards writing, publishing, certification, and continuing education, ASHRAE and its members are dedicated to promoting a healthy and sustainable built environment for all, through strategic partnerships with organizations in the HVAC&R community and across related industries.

To stay current with this and other ASHRAE Standards and Guidelines, visit www.ashrae.org/standards, and connect on LinkedIn, Facebook, Twitter, and YouTube.

Visit the ASHRAE Bookstore

ASHRAE offers its Standards and Guidelines in print, as immediately downloadable PDFs, and via ASHRAE Digital Collections, which provides online access with automatic updates as well as historical versions of publications. Selected Standards and Guidelines are also offered in redline versions that indicate the changes made between the active Standard or Guideline and its previous edition. For more information, visit the Standards and Guidelines section of the ASHRAE Bookstore at www.ashrae.org/bookstore.

IMPORTANT NOTICES ABOUT THIS GUIDELINE

To ensure that you have all of the approved addenda, errata, and interpretations for this Guideline, visit www.ashrae.org/standards to download them free of charge.

Addenda, errata, and interpretations for ASHRAE Standards and Guidelines are no longer distributed with copies of the Standards and Guidelines. ASHRAE provides these addenda, errata, and interpretations only in electronic form to promote more sustainable use of resources.