



ADDENDA

**ASHRAE Addendum e to
ASHRAE Guideline 36-2024**

High-Performance Sequences of Operation for HVAC Systems

Approved by ASHRAE on September 16, 2026.

This addendum was approved by a Standing Guideline Project Committee (SGPC) for which the Standards Committee has established a documented program for regular publication of addenda or revisions, including procedures for timely, documented, consensus action on requests for change to any part of the guideline. Instructions for how to submit a change can be found on the ASHRAE® website (www.ashrae.org/continuous-maintenance).

The latest edition of an ASHRAE Standard may be purchased on the ASHRAE website (www.ashrae.org) or from ASHRAE Customer Service, 180 Technology Parkway, Peachtree Corners, GA 30092. E-mail: orders@ashrae.org. Fax: 678-539-2129. Telephone: 404-636-8400 (worldwide), or toll free 1-800-527-4723 (for orders in US and Canada). For reprint permission, go to www.ashrae.org/permissions.

ASHRAE Standing Guideline Project Committee 36

Cognizant TC: 1.4, Control Theory and Application

SPLS Liaison: Brendon Joseph Burley

Reece Kiriū,* <i>Chair</i>	Bernard Clement	Tharanga Jayarathne	Edward Renshaw
JoeDon Breda,* <i>Vice Chair</i>	James J. Coogan	Eric Koepfel*	David Roberts
Ken Gilbert, <i>Secretary</i>	Horacio Cornejo	Elizabeth A. Kolacki	Sarah M. Rock
Christopher A. Adams	James M. Del Monaco	Xing Lu	Joseph M. Ruggiero*
Christopher R. Amundson	Clark R. Denson	Jeffrey McEntee	John R. Rundell
Jason A. Atkisson	Samuel Desmeules	Christopher McGowan	Brian W. Russell
Grace Bailey	Karthikeya Devaprasad	Christopher A. Miller	Patrick E. Ryan
Tobias Karl-Hermann Barth	Kieran Donohue	Mark F. Miller	Jonathan Smith*
Christopher Battisti	Paul W. Ehrlich*	Kevin Ng	Ryan Soo*
Daniel Bersohn	Brent R. Eubanks*	Helen O'Reilly	Raf Sowacki
Ian Bonadeo	Richard A. Farmer	Gwelen Paliaga	Iain W. Stewart
Barry B. Bridges	Michael Galler*	Chirag D. Parikh*	Marc Tardif
Lance Brown	Ernesto Garrote	James Parker	Gregori J. Tayco
Anthony Bruno	Joshua Godwin	Guy Perreault	Steven T. Taylor
Jayson F. Bursill*	Sam Gohman	Amanda Pertzborn	Kevin Teakell
Cynthia A. Callaway*	Christopher S. Gosline	Thiago Corrêa Fonseca Portes	Juan M. Torres*
Maria G. Campos	Todd Gottshall*	Michael A. Pouchak*	Alexander J. Trueblood
Elena G. Charming	Milica Grahovac	David J. Pritchard	Trevor B. Zeller
Yan Chen*	Greg M. Gross	Te Qi	Xiaohui Zhou
C. Hwakong Cheng	Kyle W. Hasenkox	Paul Raftery*	Wangda Zuo

* Denotes members of voting status when the document was approved for publication

ASHRAE STANDARDS COMMITTEE 2026–2027

Jennifer I. Pille, <i>Chair</i>	Jayson Bursill	Tatsuro Kobayashi	Nadja Tremblay
Justin M. Prosser, <i>Vice Chair</i>	Kelley P. Cramm	Toby K.W. Lau	Douglas K. Tucker
Anthony M. Abate	Abdel K. Darwich	Cesar L. Lim	Thomas E. Watson
Omar A. Abdelaziz	Drake Erbe	Paul A. Lindahl, Jr.	David P. Yuill
Charles S. Barnaby	Marcus Hassen	Kenneth A. Monroe	Patrick C. Marks, <i>BOD ExO</i>
John H. Bean	William M. Healy	Philip J. Naughton	Trenton S. Hunt, <i>CO</i>
Coleman L. Brumley, Jr.	Satish N. Iyengar	Michael P. Patton	
Brendon J. Burley	Derrick Knight	Rusty C. Tharp	
Ryan Shanley, <i>Group Manager of Codes and Standards</i>			

SPECIAL NOTE

This Guideline was developed under the auspices of ASHRAE. ASHRAE Guidelines are developed under a review process, identifying a Guideline for the design, testing, application, or evaluation of a specific product, concept, or practice. As a Guideline it is not definitive but encompasses areas where there may be a variety of approaches, none of which must be precisely correct. ASHRAE Guidelines are written to assist professionals in the area of concern and expertise of ASHRAE's Technical Committees and Task Groups.

ASHRAE Guidelines are prepared by Project Committees appointed specifically for the purpose of writing Guidelines. The Project Committee Chair and Vice-Chair must be members of ASHRAE; while other committee members may or may not be ASHRAE members, all must be technically qualified in the subject area of the Guideline.

Development of ASHRAE Guidelines follows procedures similar to those for ASHRAE Standards except that (a) committee balance is desired but not required, (b) an effort is made to achieve consensus but consensus is not required, (c) Guidelines are not appealable, and (d) Guidelines are not submitted to ANSI for approval.

The Senior Manager of Standards of ASHRAE should be contacted for

- interpretation of the contents of this Guideline,
- participation in the next review of the Guideline,
- offering constructive criticism for improving the Guideline, or
- permission to reprint portions of the Guideline.

DISCLAIMER

ASHRAE uses its best efforts to promulgate Standards and Guidelines for the benefit of the public in light of available information and accepted industry practices. However, ASHRAE does not guarantee, certify, or assure the safety or performance of any products, components, or systems tested, installed, or operated in accordance with ASHRAE's Standards or Guidelines or that any tests conducted under its Standards or Guidelines will be nonhazardous or free from risk.

ASHRAE INDUSTRIAL ADVERTISING POLICY ON STANDARDS

ASHRAE Standards and Guidelines are established to assist industry and the public by offering a uniform method of testing for rating purposes, by suggesting safe practices in designing and installing equipment, by providing proper definitions of this equipment, and by providing other information that may serve to guide the industry. The creation of ASHRAE Standards and Guidelines is determined by the need for them, and conformance to them is completely voluntary.

In referring to this Standard or Guideline and in marking of equipment and in advertising, no claim shall be made, either stated or implied, that the product has been approved by ASHRAE.

(This foreword is not part of this guideline. It is merely informative and does not contain requirements necessary for conformance to the guideline. It has not been processed according to the ANSI requirements for a guideline and may contain material that has not been subject to public review or a consensus process. Unresolved objectors on informative material are not offered the right to appeal at ASHRAE or ANSI.)

FOREWORD

This addendum fixes errors in the equations used for FC #4 and #5 as well as removes redundant text and updates formatting for consistency with the AHU AFDD sections. Also adds clarifications on which fault conditions apply based on FCU configuration.

Note: In this addendum, changes to the current guideline are indicated in the text by underlining (for additions) and strikethrough (for deletions) unless the instructions specifically mention some other means of indicating the changes. Only these changes are open for review and comment at this time. Additional material is provided for context only and is not open for comment except as it relates to the proposed substantive changes.

Addendum e to Guideline 36-2021

(IP and SI Units)

Revise Section 5.22.6 as follows:

5.22.6. Automatic Fault Detection and Diagnostics

Automatic fault detection and diagnostics (AFDD) is a sophisticated system for detecting and diagnosing air-handler faults.

To function correctly, AFDD requires specific sensors and data be available, as detailed in the sequences below. If this information is not available, AFDD tests that do not apply should be deleted.

The AFDD routines for FCUs continually assess FCU performance by comparing the values of BAS inputs and outputs to a subset of potential fault conditions. The subset of potential fault conditions that is assessed at any point depends on the operating state (OS) of the ~~AHU~~FCU, as determined by the position of the cooling and heating valves. Time delays are applied to the evaluation and reporting of fault conditions to suppress false alarms. Fault conditions that pass these filters are reported to the building operator along with a series of possible causes.

These equations assume that the FCU is equipped with hydronic heating and cooling coils. If any of these components are not present, the associated tests and variables should be omitted from the programming.

5.22.6.1. AFDD conditions are evaluated continuously and separately for each operating FCU.

5.22.6.2. The OS of each FCU shall be defined by the commanded positions of the heating-coil control valve and cooling-coil control valve in accordance with Table 5.22.6.2 and Figure 5.22.6.2.

Table 5.22.6.2 FCU Operating States

Operating State	Heating Valve Position	Cooling Valve Position
#1: Heating	> 0	= 0
#2 No Heating or Cooling	= 0	= 0
#3: Cooling	= 0	> 0
#4 Unknown	No other OS applies	

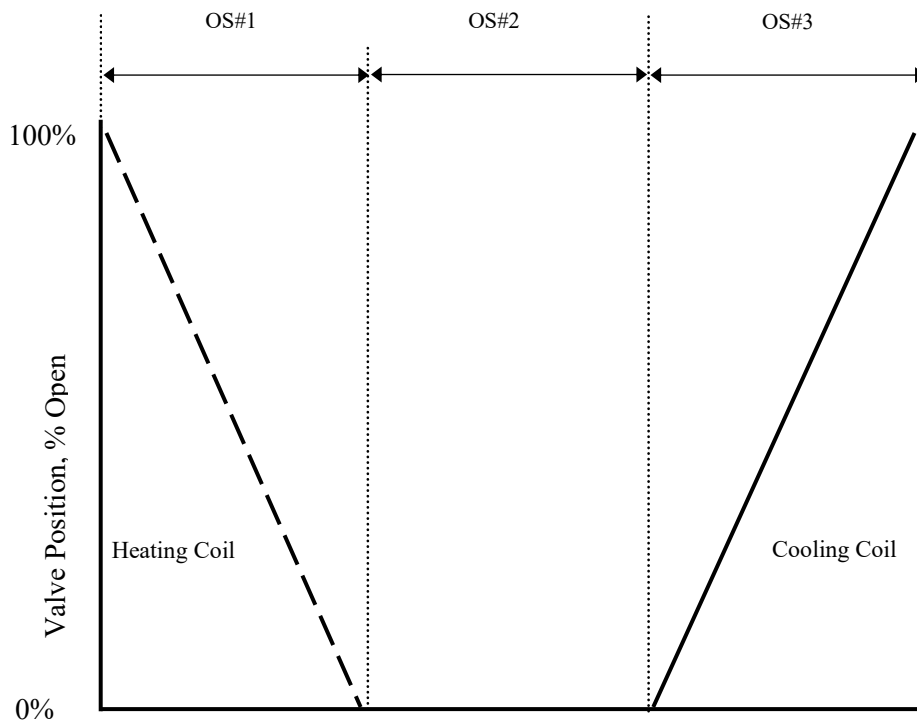


Figure 5.22.6.22 FCU operating states.

The OS is distinct from, and should not be confused with, the zone status (cooling, heating, deadband).

OS#1 through OS#3 (see Table 5.22.6.2) represent normal operation during which a fault may nevertheless occur if so determined by the fault condition tests in Section 5.22.6.5.18.13.5. By contrast, OS#4 may represent an abnormal or incorrect condition (such as simultaneous heating and cooling) arising from a controller failure or programming error.

5.22.6.3. The following points must be available to the AFDD routines for each FCU:

For the AFDD routines to be effective, an averaging sensor is recommended for the supply air temperature but it is noted that in most cases a single point sensor will be provided with the FCU.

- a. SAT = supply air temperature
- b. RAT = return air temperature (if present)
- c. SATsp = supply air temperature setpoint
- d. HC = heating coil valve position command; $0\% \leq HC \leq 100\%$
- e. CC = cooling coil valve position command; $0\% \leq CC \leq 100\%$
- f. FS = fan speed command; $0\% \leq FS \leq 100\%$

5.22.6.4. The following values must be continuously calculated by the AFDD routines for each FCU:

- a. Five minute rolling averages with 1 minute sampling of the following point values; operator shall have the ability to adjust the averaging window and sampling period for each point independently.
 - 1. SAT_{avg} = rolling average of supply air temperature
 - 2. RAT_{avg} = rolling average of return air temperature (if fitted)
 - 3. AOS = number of changes in OS during the previous 60 minutes (moving window)

5.22.6.3. For each FCU, the following values must be continuously monitored or determined by the AFDD routines

and mapped to the indicated variables, which are used in the fault detection equations that follow.

- a. Continuously measure the following points:
 1. SAT_{sp} = supply air temperature setpoint
 2. HC = heating-coil valve position command; $0\% \leq HC \leq 100\%$
 3. CC = cooling-coil valve position command; $0\% \leq CC \leq 100\%$
 4. FS = fan-speed command; $0\% \leq FS \leq 100\%$
- b. Calculate five-minute rolling averages with one-minute sampling time of the following point values; operator shall have the ability to adjust the averaging window and sampling period for each point independently.
 1. SAT_{avg} = rolling average of supply air temperature
 2. RAT_{avg} = rolling average of return air temperature
- c. ΔOS = number of changes in OS during the previous 60 minutes (moving window)

5.22.6.4. The internal variables shown in Table 5.22.6.5 shall be defined for each FCU. All parameters are adjustable by the operator, with initial values as given below.

Default values are derived from NISTIR 7365 and have been validated in field trials. They are expected to be appropriate for most circumstances, but individual installations may benefit from tuning to improve sensitivity and reduce false alarms.

The default values have been intentionally biased toward minimizing false alarms, if necessary at the expense of missing real alarms. This avoids excessive false alarms that will erode user confidence and responsiveness. However, if the goal is to achieve the best possible energy performance and system operation, these values should be adjusted based on field measurement and operational experience.

Values for physical factors such as fan heat, duct heat gain, and sensor error can be measured in the field or derived from trend logs. Likewise, the occupancy delay and switch delays can be refined by observing in trend data the time required to achieve quasi steady state operation.

Other factors can be tuned by observing false positives and false negatives (i.e., unreported faults). If transient conditions or noise cause false errors, increase the alarm delay. Likewise, failure to report real faults can be addressed by adjusting the heating coil, cooling coil, temperature, or flow thresholds.

Table 5.22.6.45-22.6.5 FCU Internal Variables

Variable Name	Description	Default Value
ΔT _{SF}	Temperature rise across supply fan	0.5°C (1°F)
ε _{SAT}	Temperature error threshold for SAT sensor	1°C (2°F)
ε _{RAT}	Temperature error threshold for RAT sensor	1°C (2°F)
ΔOS _{max}	Maximum number of changes in Operating State during the previous 60 minutes (moving window)	7
ModeDelay	Time in minutes to suspend Fault Condition evaluation after a change in mode	30
AlarmDelay	Time in minutes that a Fault Condition must persist before triggering an alarm	30
TestModeDelay	Time in minutes that Test Mode is enabled	120

The purpose of TestModeDelay is to ensure that normal fault reporting occurs after the testing and commissioning process is completed as described in Section 5.22.6.105-18.13.11.

5.22.6.5. Table ~~5.20.6.6~~ 5.22.6.5 shows potential fault conditions that can be evaluated by the AFDD routines.

- a. If the equation statement is TRUE, then the specified fault condition exists. ~~The fault conditions to be evaluated at any given time will depend on the OS of the AHU.~~
- b. Only those fault condition equations that apply to the current OS of the AHU shall be evaluated.

The equations in Table ~~5.20.6.6~~ 5.22.6.5 assume that the SAT sensor is located downstream of the supply fan and the RAT sensor is located upstream of the supply fan. If actual sensor locations differ from these assumptions, it may be necessary to add or delete fan heat correction factors.

Table ~~5.22.6.5~~ 5.22.6.6 FCU Fault Conditions

FC #1	Equation	$\Delta OS > \Delta OS_{MAX}$	Applies to OS #1 – #4
	Description	Too many changes in Operating State	
	Possible Diagnosis	Unstable control due to poorly tuned loop or mechanical problem	
FC #2	Equation	$SAT_{AVG} < SATSP - \epsilon_{SAT}$ and $HC \geq 99\%$	Applies to OS #1 (if heating coil)
	Description	SAT too low in full heating	
	Possible Diagnosis	SAT sensor error Cooling coil valve leaking or stuck open Heating coil valve stuck closed or actuator failure Fouled or undersized heating coil HW temperature too low, <u>HW DP too low</u> or HW unavailable Gas or electric heat is unavailable DX cooling is stuck on	
FC #3	Equation	$SAT_{AVG} > SAT_{SP} + \epsilon_{SAT}$ and $CC \geq 99\%$	Applies to OS #3 (if cooling coil)
	Description	SAT too high in full cooling	
	Possible Diagnosis	SAT sensor error Cooling coil valve stuck closed or actuator failure Fouled or undersized cooling coil CHW temperature too high, <u>CHW DP too low</u> or CHW unavailable DX cooling unavailable Gas or electric heat stuck on Heating coil valve leaking or stuck open	
FC#4	Equation	$\frac{RAT_{AVG} - SAT_{AVG} - RAT}{\Delta T_{SF}} \geq \sqrt{\epsilon_{RAT}^2 + \epsilon_{SAT}^2} + \epsilon_{FCU}$	Applies to OS #2 (cooling only FCU with RAT)(if cooling coil with RAT)
	Description	Temperature drop across inactive cooling coil	
	Possible Diagnosis	RAT sensor error SAT sensor error Cooling coil valve stuck open or leaking DX cooling stuck on	

FC#5	Equation	$SAT_{AVG} - RAT_{AVG} \geq \sqrt{\epsilon_{RAT}^2 + \epsilon_{SAT}^2 + \Delta T_{SF}}$	Applies to OS #2 (heating only FCU with RAT)(if heating coil with RAT)
	Description	Temperature rise across inactive heating coil	
	Possible Diagnosis	RAT sensor error SAT sensor error Heating coil valve stuck open or leaking Gas or electric heat stuck on	

~~5.22.6.6. A subset of all potential fault conditions is evaluated by the AFDD routines. The set of applicable fault conditions depends on the OS of the FCU.~~

~~a. In OS#1 (Heating), the following fault conditions shall be evaluated:~~

- ~~1. FC#1: Too many changes in OS~~
- ~~2. FC#2: SAT too low in full heating~~

~~b. In OS#2 (Deadband), the following fault conditions shall be evaluated:~~

- ~~1. FC#5: Temperature drop across inactive heating coil (heating only FCU~~
- ~~2. FC#4: Temperature drop across inactive cooling coil (cooling only FCU~~

~~c. In OS#3 (Cooling), the following fault conditions shall be evaluated:~~

- ~~1. FC#1: Too many changes in OS~~
- ~~2. FC#3: SAT too high in full cooling~~

~~d. In OS#4 (other), the following fault conditions shall be evaluated:~~

- ~~1. FC#1: Too many changes in OS~~

5.22.6.6. For each FCU, the operator shall be able to suppress the alarm for any fault condition.

5.22.6.7. Evaluation of fault conditions shall be suspended under the following conditions:

- a. When FCU is not operating
- b. For a period of ModeDelay minutes following a change in mode (e.g., from Warmup Mode or Cooldown Mode to Occupied Mode) of any Zone Group served by the FCU.

5.22.6.8. Fault conditions that are not applicable to the current OS shall not be evaluated.

5.22.6.9. A fault condition that evaluates as true must do so continuously for AlarmDelay minutes before it is reported to the operator.

5.22.6.10. Test mode shall temporarily set ModeDelay and AlarmDelay to 0 minutes for a period of TestModeDelay minutes to allow instant testing of the AFDD system and ensure normal fault detection occurs after testing is complete.

5.22.6.11. When a fault condition is reported to the operator, it shall be a Level 3 alarm and shall include the description of the fault and the list of possible diagnoses from Table 5.22.6.5.

POLICY STATEMENT DEFINING ASHRAE'S CONCERN FOR THE ENVIRONMENTAL IMPACT OF ITS ACTIVITIES

ASHRAE is concerned with the impact of its members' activities on both the indoor and outdoor environment. ASHRAE's members will strive to minimize any possible deleterious effect on the indoor and outdoor environment of the systems and components in their responsibility while maximizing the beneficial effects these systems provide, consistent with accepted Standards and the practical state of the art.

ASHRAE's short-range goal is to ensure that the systems and components within its scope do not impact the indoor and outdoor environment to a greater extent than specified by the Standards and Guidelines as established by itself and other responsible bodies.

As an ongoing goal, ASHRAE will, through its Standards Committee and extensive Technical Committee structure, continue to generate up-to-date Standards and Guidelines where appropriate and adopt, recommend, and promote those new and revised Standards developed by other responsible organizations.

Through its *Handbook*, appropriate chapters will contain up-to-date Standards and design considerations as the material is systematically revised.

ASHRAE will take the lead with respect to dissemination of environmental information of its primary interest and will seek out and disseminate information from other responsible organizations that is pertinent, as guides to updating Standards and Guidelines.

The effects of the design and selection of equipment and systems will be considered within the scope of the system's intended use and expected misuse. The disposal of hazardous materials, if any, will also be considered.

ASHRAE's primary concern for environmental impact will be at the site where equipment within ASHRAE's scope operates. However, energy source selection and the possible environmental impact due to the energy source and energy transportation will be considered where possible. Recommendations concerning energy source selection should be made by its members.

ASHRAE · 180 Technology Parkway · Peachtree Corners, GA 30092 · www.ashrae.org

About ASHRAE

Founded in 1894, ASHRAE is a global professional society committed to serve humanity by advancing the arts and sciences of heating, ventilation, air conditioning, refrigeration, and their allied fields.

As an industry leader in research, standards writing, publishing, certification, and continuing education, ASHRAE and its members are dedicated to promoting a healthy and sustainable built environment for all, through strategic partnerships with organizations in the HVAC&R community and across related industries.

To stay current with this and other ASHRAE Standards and Guidelines, visit www.ashrae.org/standards, and connect on LinkedIn, Facebook, Twitter, and YouTube.

Visit the ASHRAE Bookstore

ASHRAE offers its Standards and Guidelines in print, as immediately downloadable PDFs, and via ASHRAE Digital Collections, which provides online access with automatic updates as well as historical versions of publications. Selected Standards and Guidelines are also offered in redline versions that indicate the changes made between the active Standard or Guideline and its previous edition. For more information, visit the Standards and Guidelines section of the ASHRAE Bookstore at www.ashrae.org/bookstore.

IMPORTANT NOTICES ABOUT THIS GUIDELINE

To ensure that you have all of the approved addenda, errata, and interpretations for this Guideline, visit www.ashrae.org/standards to download them free of charge.

Addenda, errata, and interpretations for ASHRAE Standards and Guidelines are no longer distributed with copies of the Standards and Guidelines. ASHRAE provides these addenda, errata, and interpretations only in electronic form to promote more sustainable use of resources.